



REV.	APPR. BY	DATE

REV.	APPR. BY	DATE

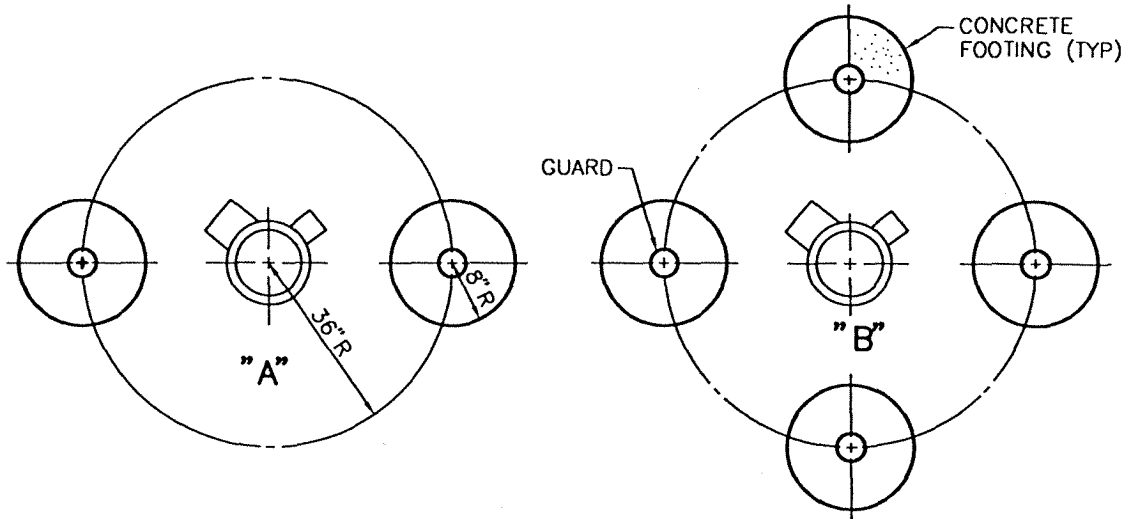

STANDARD FIRE HYDRANT

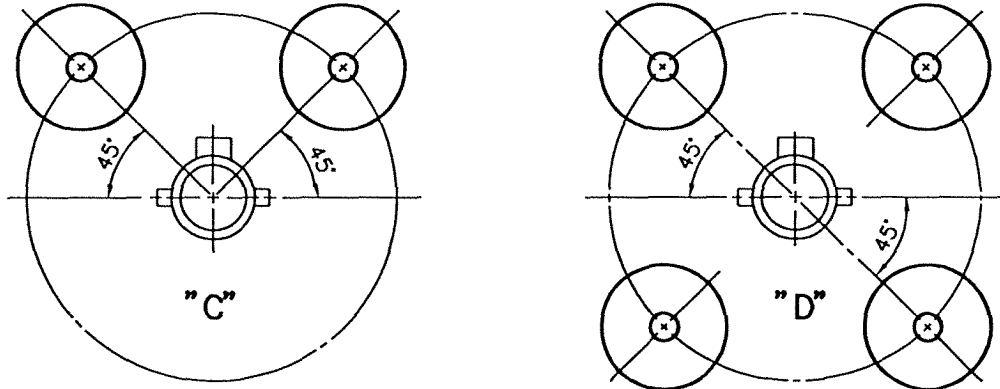

THREE-OUTLET FIRE HYDRANT

NOTES:

1. CONCRETE FOOTING SHALL EXTEND 3' BELOW SURFACE.
2. GUARD SHALL BE 5'-6" IN LENGTH EXTENDING 2'-6" ABOVE THE SURFACE AND SHALL BE 3" STEEL PIPE FILLED WITH CONCRETE.
3. VARIATIONS OF THE ABOVE ARRANGEMENTS MAY BE REQUIRED UNDER UNUSUAL CIRCUMSTANCES.
4. GUARD TO BE PAINTED THE SAME AS FIRE HYDRANT.



CITY OF

TYPICAL BARRICADES FOR FIRE HYDRANT

DRAWN: STAFF CKD.: STAFF
 Department of Public Works

APPR. *Granville M. Bowman*
 Granville M. Bowman

STANDARD PLAN
 2002

PLATE 301

SHEET 1 OF 1