


REV.	APPR. BY	DATE

REV.	APPR. BY	DATE

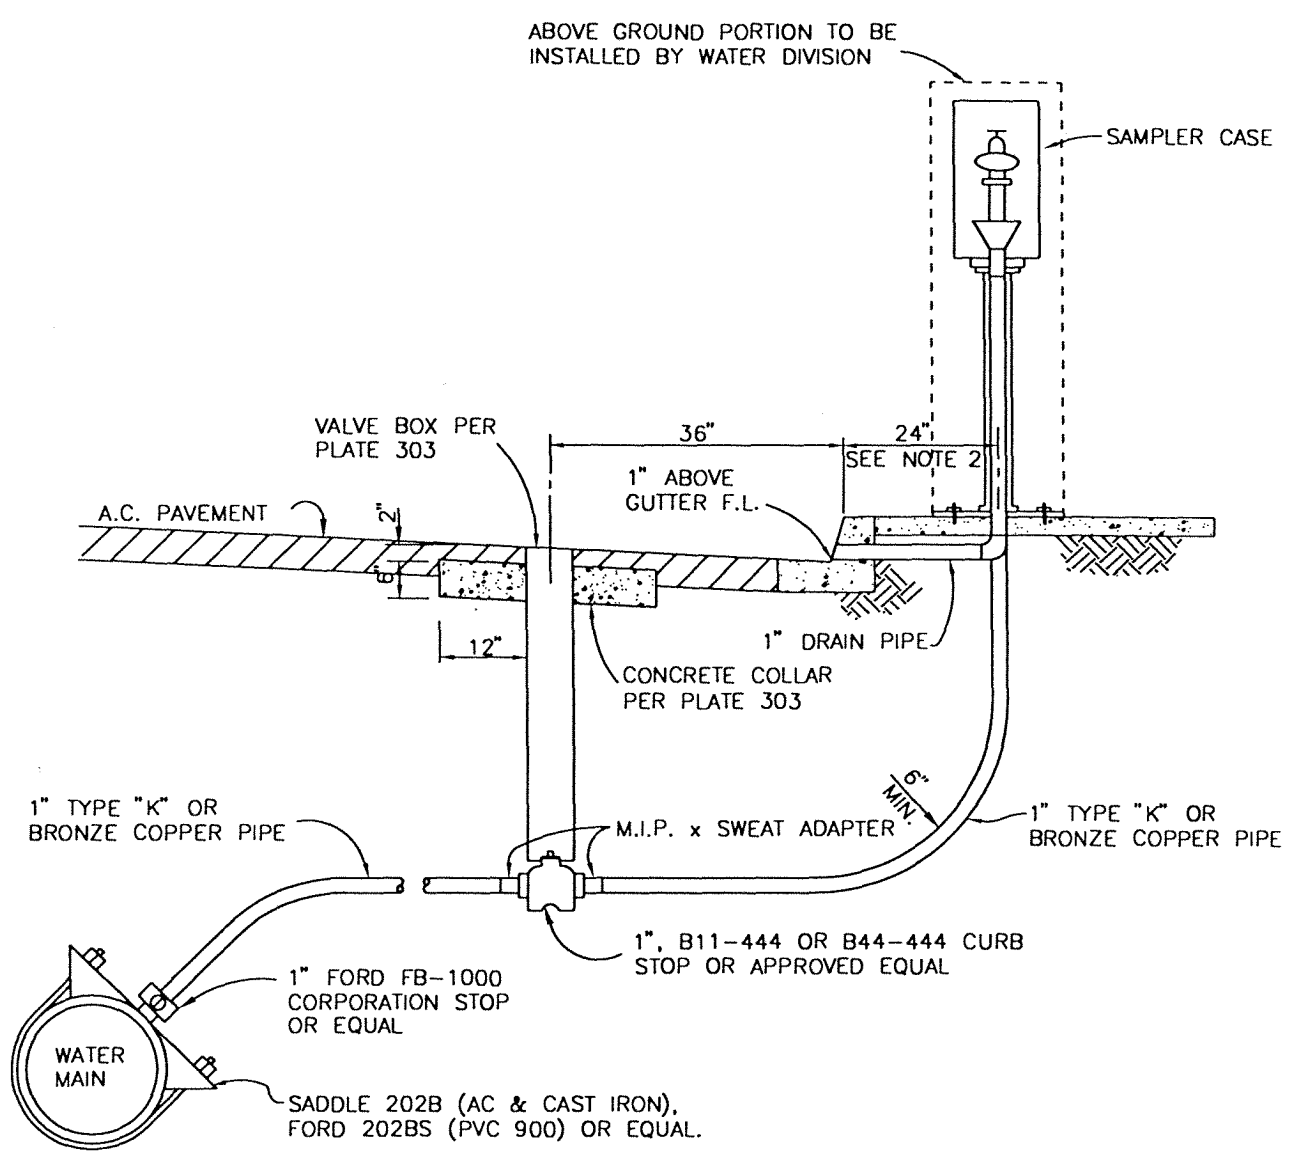

NOTES:

1. SAMPLER MAY BE INSTALLED IN PARKWAY WITH A 24" SQ. x 6" CONCRETE PAD.
2. SAMPLER SHALL BE 18" FROM FACE OF CURB IF SIDEWALK IS ADJACENT TO CURB AND 5' OR LESS IN WIDTH.
3. CONTRACTOR TO INSTALL ALL BELOW GROUND PORTIONS OF SAMPLING STATION INCLUDING MIN. 36" DRAIN LINE AND SERVICE LINE RISERS ABOVE FINISH SIDEWALK ELEVATION.

	WATER SAMPLING STATION		STANDARD PLAN 2D02
	DRAWN: STAFF	CKD.: STAFF	PLATE 315
Department of Public Works		APPR.	SHEET 1 OF 1