


REV.	APPR. BY	DATE

REV.	APPR. BY	DATE
1	L. BALDERRAMA	6/16/16
2	Robert Hearne	4/11/18

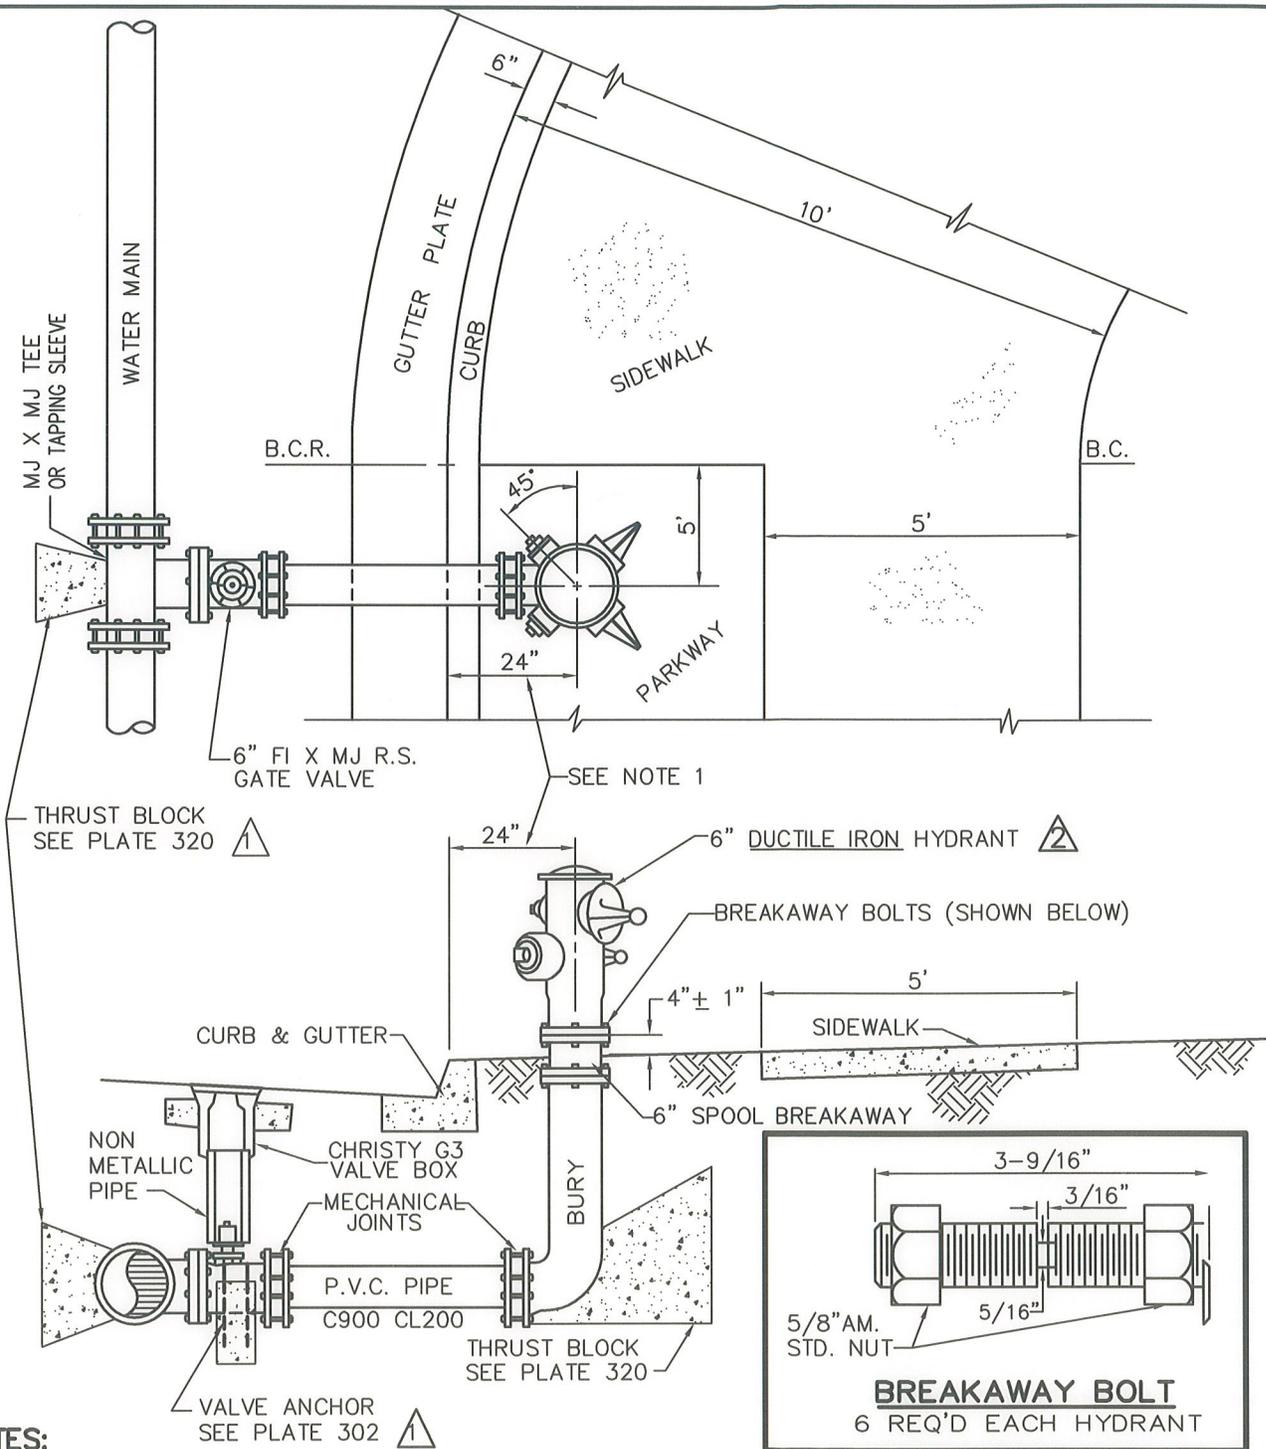

**NOTES:**

1. IF SIDEWALK IS ADJACENT TO CURB AND 5' OR LESS IN WIDTH, THEN F.H. SHALL BE PLACED 18" FROM FACE OF CURB.
2. ALL BREAKAWAY BOLTS SHALL BE CADMIUM PLATED. ALL BELOW GRADE BOLTS TO BE STAINLESS STEEL.
3. REFER TO GENERAL REQUIREMENT SECTION FOR PAINT REQUIREMENTS.
4. ALTERNATE FIRE HYDRANT LOCATIONS MAY BE APPROVED BY CITY ENGINEER.
5. COPPER LOCATION WIRE REQUIRED.
6. BLUE REFLECTIVE PAVEMENT MARKERS REQUIRED PER PLATE 202.
7. RESTRAINED JOINTS MAY BE SUBSTITUTED IN LIEU OF THRUST BLOCKS. RESTRAINED JOINTS SHALL BE MANUFACTURED BY EBAA IRON OR APPROVED EQUAL.

	<b>DETAILS FOR FIRE HYDRANT INSTALLATION</b>		STANDARD PLAN 2002
	DRAWN: C. GIRON Department of Public Works	CKD.: A. WITHANAGE	APPR. ROBERT HEARNE, PE