


## CHANNEL ISLANDS HARBOR WATER QUALITY: REMOTE SENSOR DATA – 6/14/23 THROUGH 6/20/23


Below is the weekly remote sensor data from 6/14/23 to 6/20/23. Dissolved oxygen (DO; in blue) and chlorophyll concentrations (a proxy for microscopic algal biomass, in green) were acceptable at both stations with normal daily oscillations observed. Spikes of chlorophyll concentrations (> 20  $\mu$ g/L) observed at station 6 is likely artifactual.

The City of Oxnard and Aquatic Bioassay & Consulting will continue to monitor the sensors in the area.



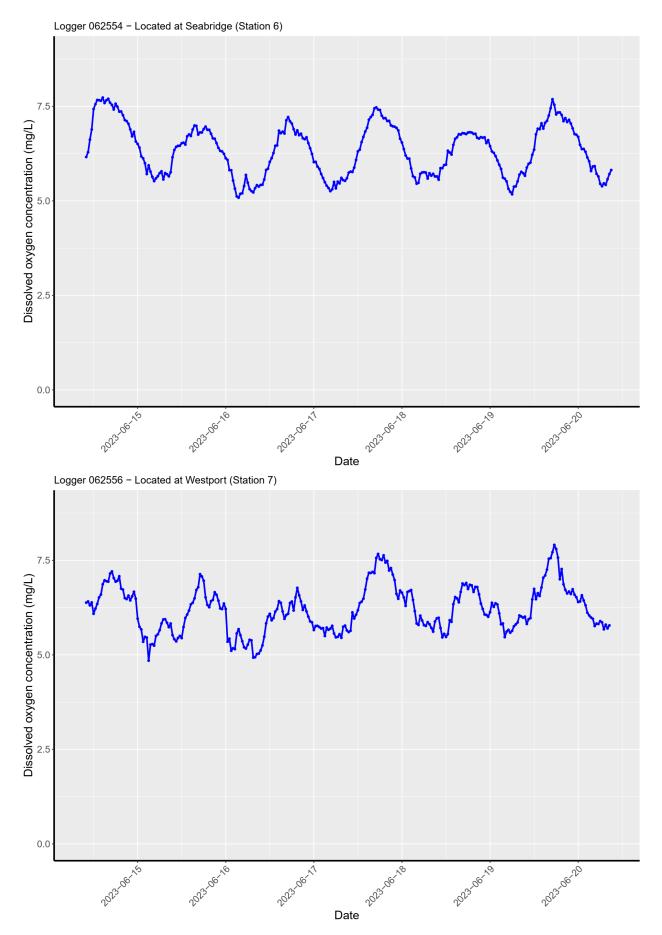

## CHANNEL ISLANDS HARBOR WATER QUALITY: REMOTE SENSOR DATA - 6/14/23 THROUGH 6/20/23

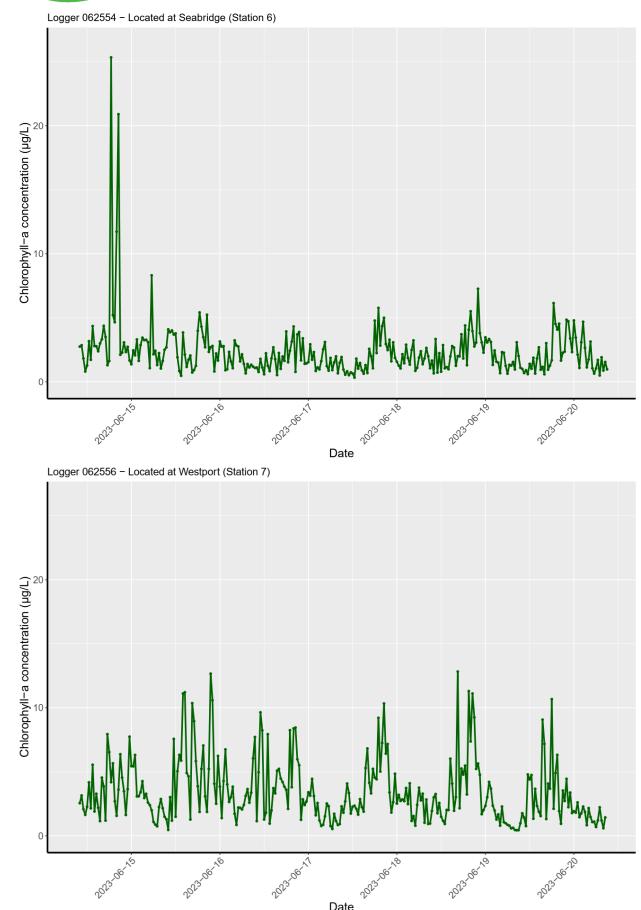

Date