

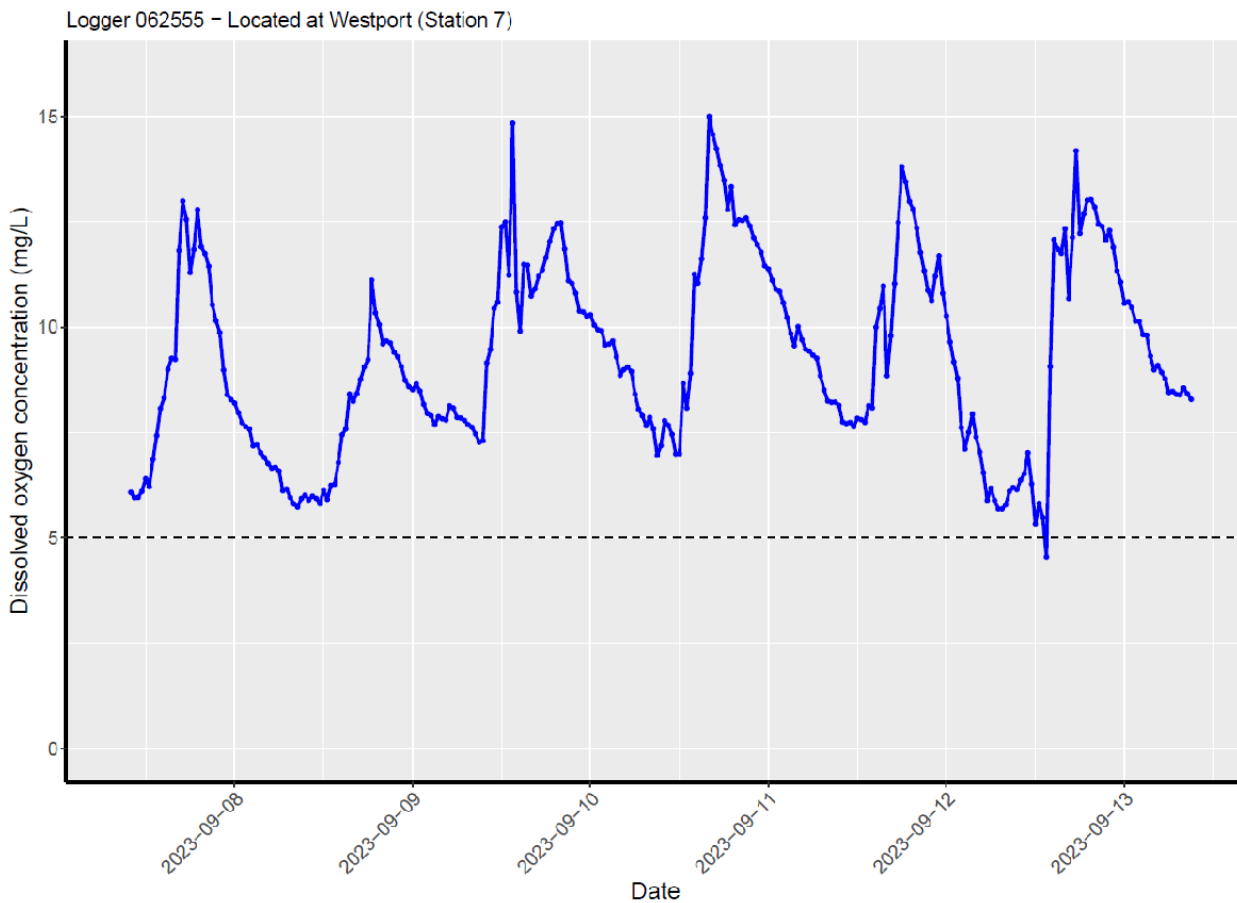


Below is the weekly remote sensor data from 9/7/23 to 9/13/23. Dissolved oxygen (DO; in blue; Black dashed line indicates 5 mg/L) went below 5 mg/L for periods (several hours) at Seabridge (station 6). Chlorophyll concentrations (a proxy for microscopic algal biomass, in green) were acceptable at Seabridge (station 6) with normal daily oscillations observed. Chlorophyll concentrations > 100 µg/L were removed (gaps in figure for Westport) as those measurements were likely artifactual.

The City of Oxnard and Aquatic Bioassay & Consulting will continue to monitor the sensors in the area.

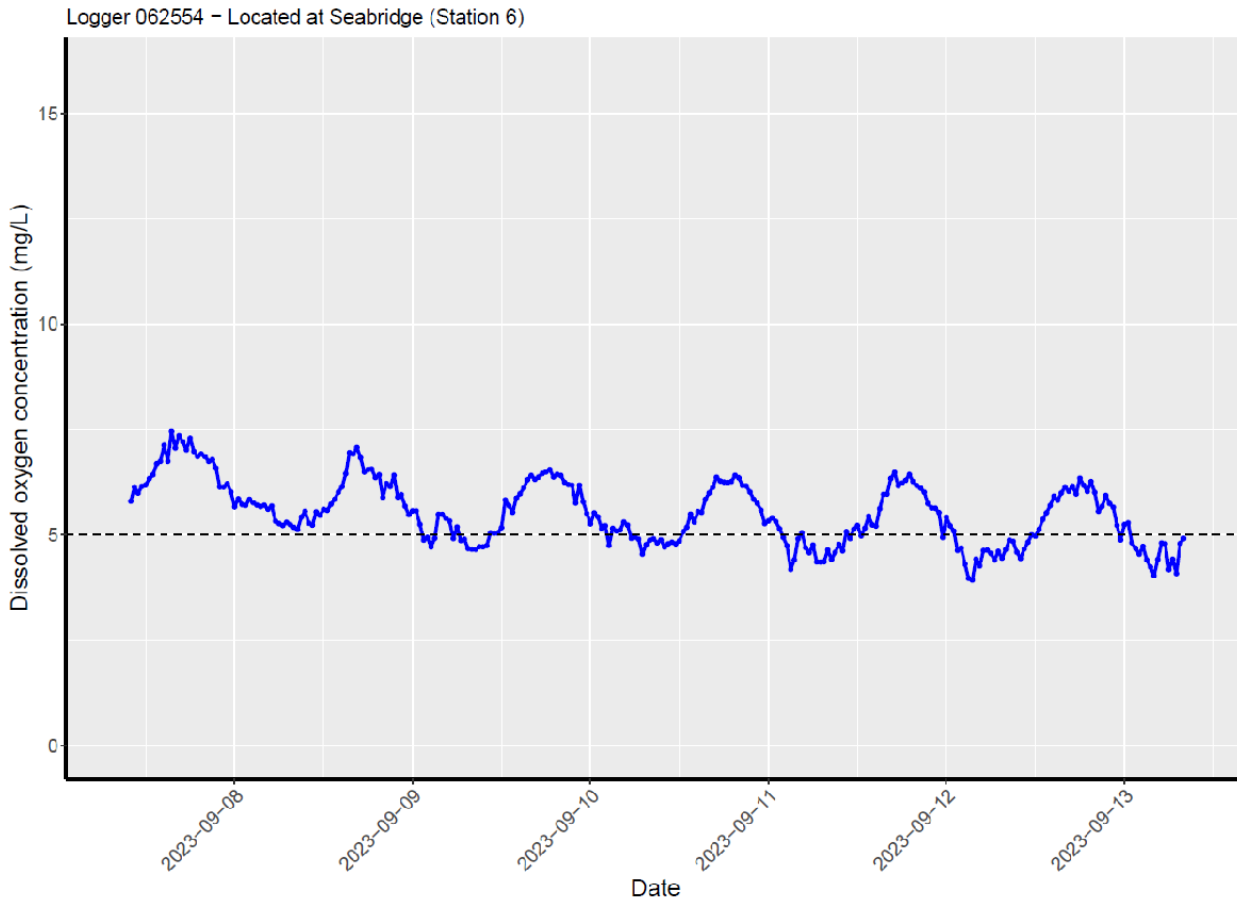

Logger 062554 – Located at Seabridge (Station 6)

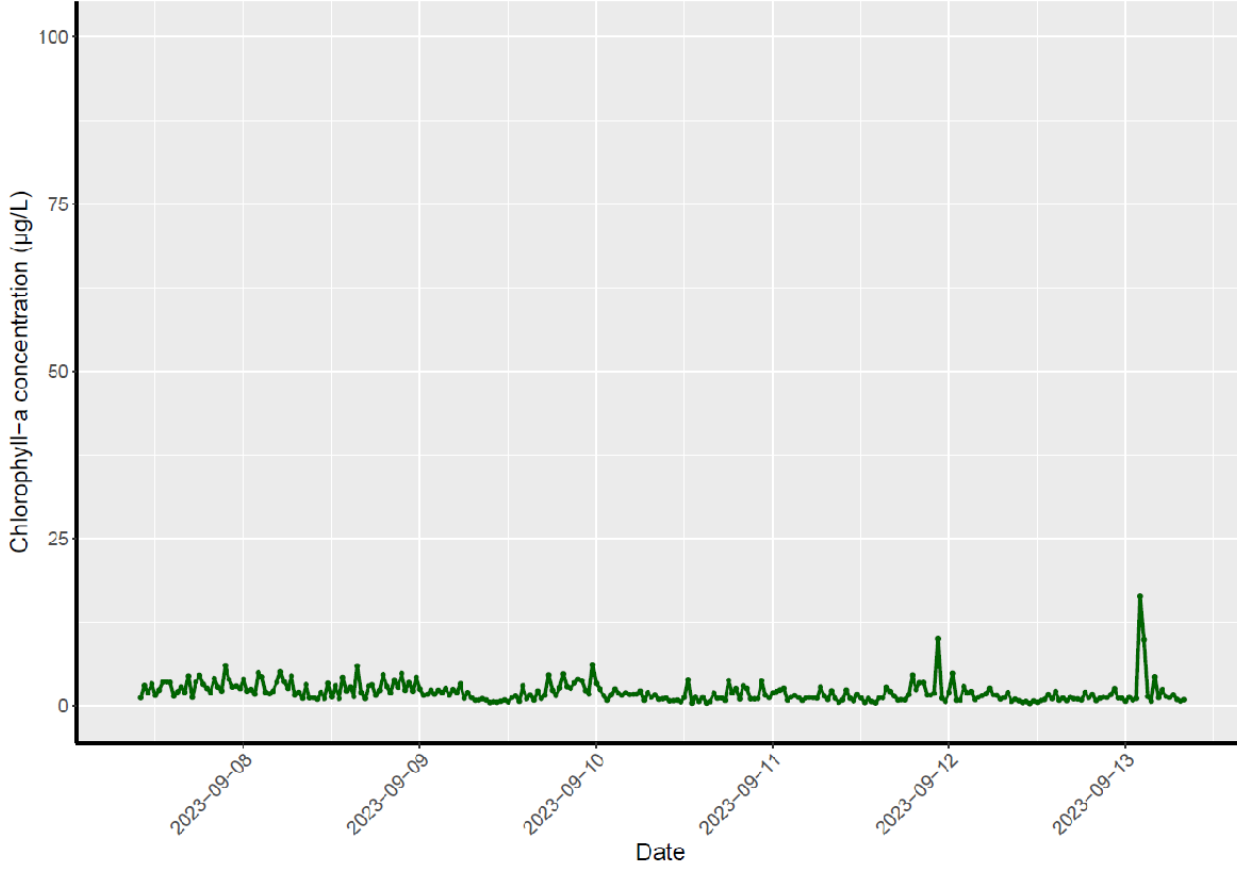

Logger 062555 – Located at Westport (Station 7)

